

MINIMUM POLE / GUY REQUIREMENTS			
POLE LENGTH (FEET)	MIN. GND. DEPTH "A"=(FEET)	MIN. GND. LINE CIRCUMFERENCE "C"=(INCHES)	MIN. GUY LENGTH WHEN REQUIRED (FEET)
30	5-1/2	23-1/2	12
25	5	19	10

NOTE: WEATHER HEAD MUST BE WITHIN 2' (24") FROM TOP OF POLE.

NOTIFY COOPERATIVE FOR METER POLE SPOT LOCATION

DISTANCE "B" SHALL BE OF SUITABLE LENGTH TO PROVIDE PROPER CLEARANCES FOR THE SERVICE DROP CABLE

IF DIMENTION "A" IS LESS THAN MINIMUM SHOWN, POLE MUST BE GUYED BY CUSTOMER OR OTHERWISE SECURED


IF SERVICE WIRE SPAN LENGTH EXCEEDS 50 FEET, A GUY WIRE MUST BE INSTALLED BY THE CONSUMER.

TWO GROUND RODS ARE REQUIRED. THE FIRST GROUND ROD SHOULD BE AT LEAST TWO FEET MINIMUM FROM THE POLE. THE SECOND GROUND ROD NEEDS TO BE A MINIMUM OF SIX FEET FROM THE FIRST GROUND ROD.

METER POLE TO BE PLACED A MINIMUM OF 3'-6" FROM TRAILER AND A MAXIMUM OF 30' FROM TRAILER.

"D" THIMBLE EYE BOLT WITH CURVED WASHER AND NUT

ALLOW FOR TELEPHONE AND TV CABLE TO MEET NESC CLEARANCE BELOW WEATHER HEAD AND DRIP LOOP.

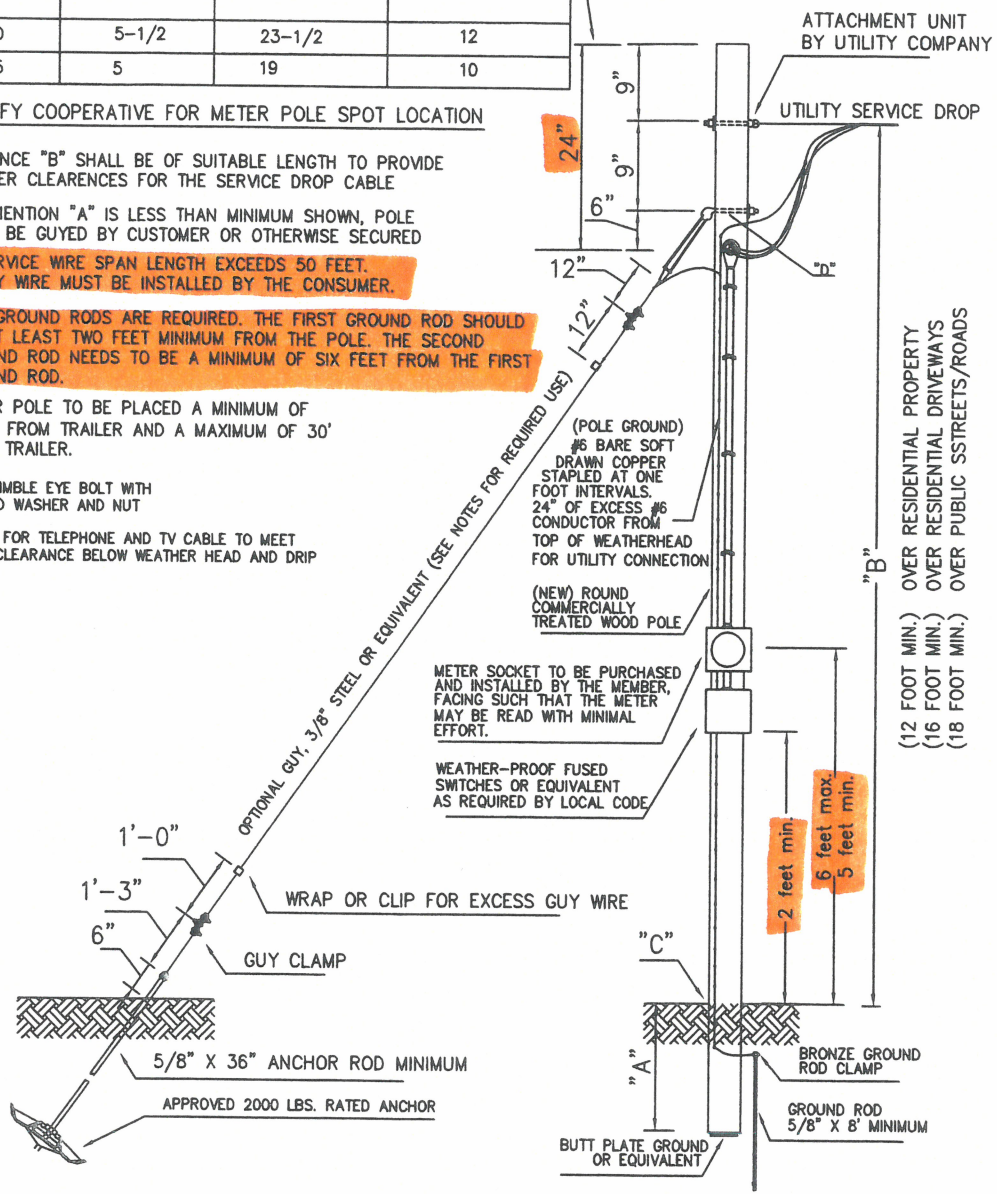

"B" OVER RESIDENTIAL PROPERTY
 (12 FOOT MIN.)
 OVER RESIDENTIAL DRIVEWAYS
 (16 FOOT MIN.)
 OVER PUBLIC STREETS/ROADS
 (18 FOOT MIN.)

Itemref	Quantity	Title/Name, designation, material, dimension etc	Article No./Reference		
Designed by JMD	Checked by. <i>Keith Ukers</i>	Approved by - date <i>and Wright 8-30-11</i>	Filename MOBILHM	Date 8-25-2011	Scale
Owner Jackson Energy Cooperative Construction Standard 115 JACKSON ENERGY LANE MCKEE, KY 40447			Title/Name Mobile Home Service Pole		
			Drawing number	Edition 1	Sheet