


Jackson Energy Cooperative

UNDERGROUND SERVICE

Policy and Guidelines

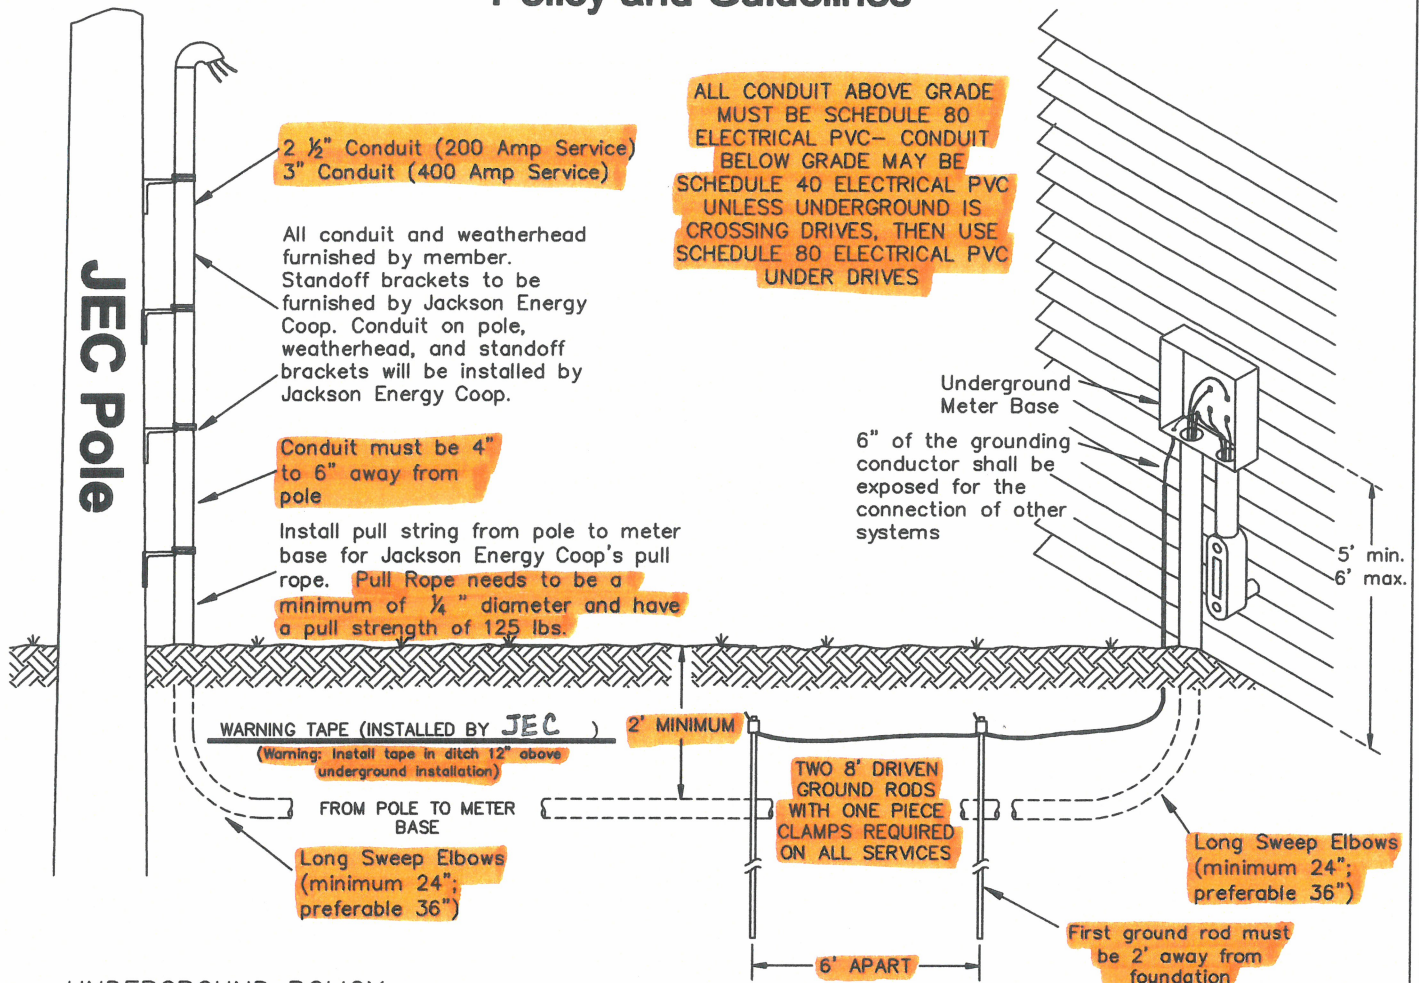

UNDERGROUND POLICY

Underground electric service will be provided to residential members if the load's main entrance is 150 amperes or greater and the member is willing to abide by all the listed specifications for installation.

Jackson Energy Coop will furnish and install the proper size wire in conduit provided by the member according to specifications.

Underground electric service will not be provided where overhead service is existing except at the member's expense, nor will overhead be provided where underground is existing except at the member's expense.

If underground electric service is desired, the member shall notify Jackson Energy Coop at the time temporary power is requested, or bear the cost if change is made.

Consumer will need to call Jackson Energy Coop before covering ditch and conduit so it can be inspected.

If consumer hits solid rock while digging the ditch, the ditch must still be at least one (1) foot deep and conduit incased in four (4) inches of concrete.