

* On compacted soil,
- Grade 57 rock, 12" MIN.-


- * REQUIRED FOR ALL SLEEVE TYPES.
- ** DOME LID VIEW ONLY

NOTES:

1. SLEEVE TO BE FREE FROM OBSTACLES A MIN OF 2 FEET ON SIDES AND REAR, AND 10 FEET FROM THE FRONT
2. ALL SECONDARY CONDUITS TO ENTER SLEEVE BY ELBOWING UNDER

THE FOLLOWING SUFFIXES TO BE ADDED TO UNIT ID

- ① T = 1 PH TRANS SLEEVE
- 1 = 1 PH SECTIONALIZER ENCLOSER SLEEVE
- 3 = 3 PH SECTIONALIZER ENCLOSER SLEEVE
- ② D = WITH DOME LID
- S = WITH STANDARD LID
- BLANK = WITH OUT LID

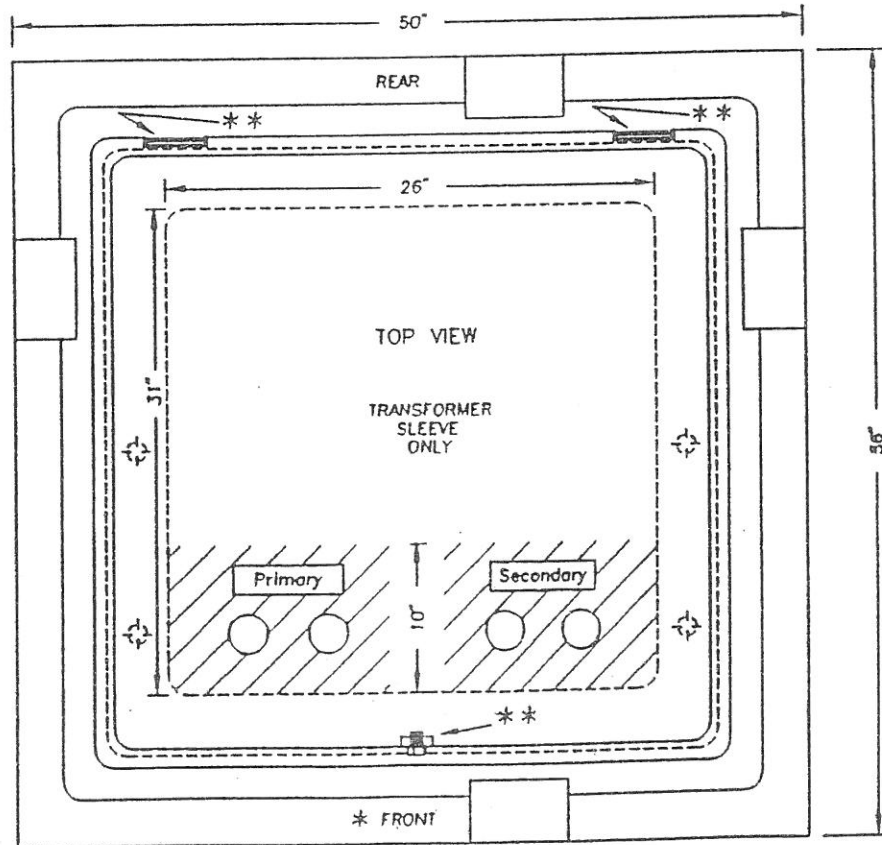

JACKSON CO RECC
 CONSTRUCTION STANDARD
 APPROVED BY: *Hevin Lytle*
 ENGINEERING MANAGER

DWN. BY KINCER
 DATE: 10-5-95

GROUND SLEEVES SPECIFICATION

JUM1-7①②